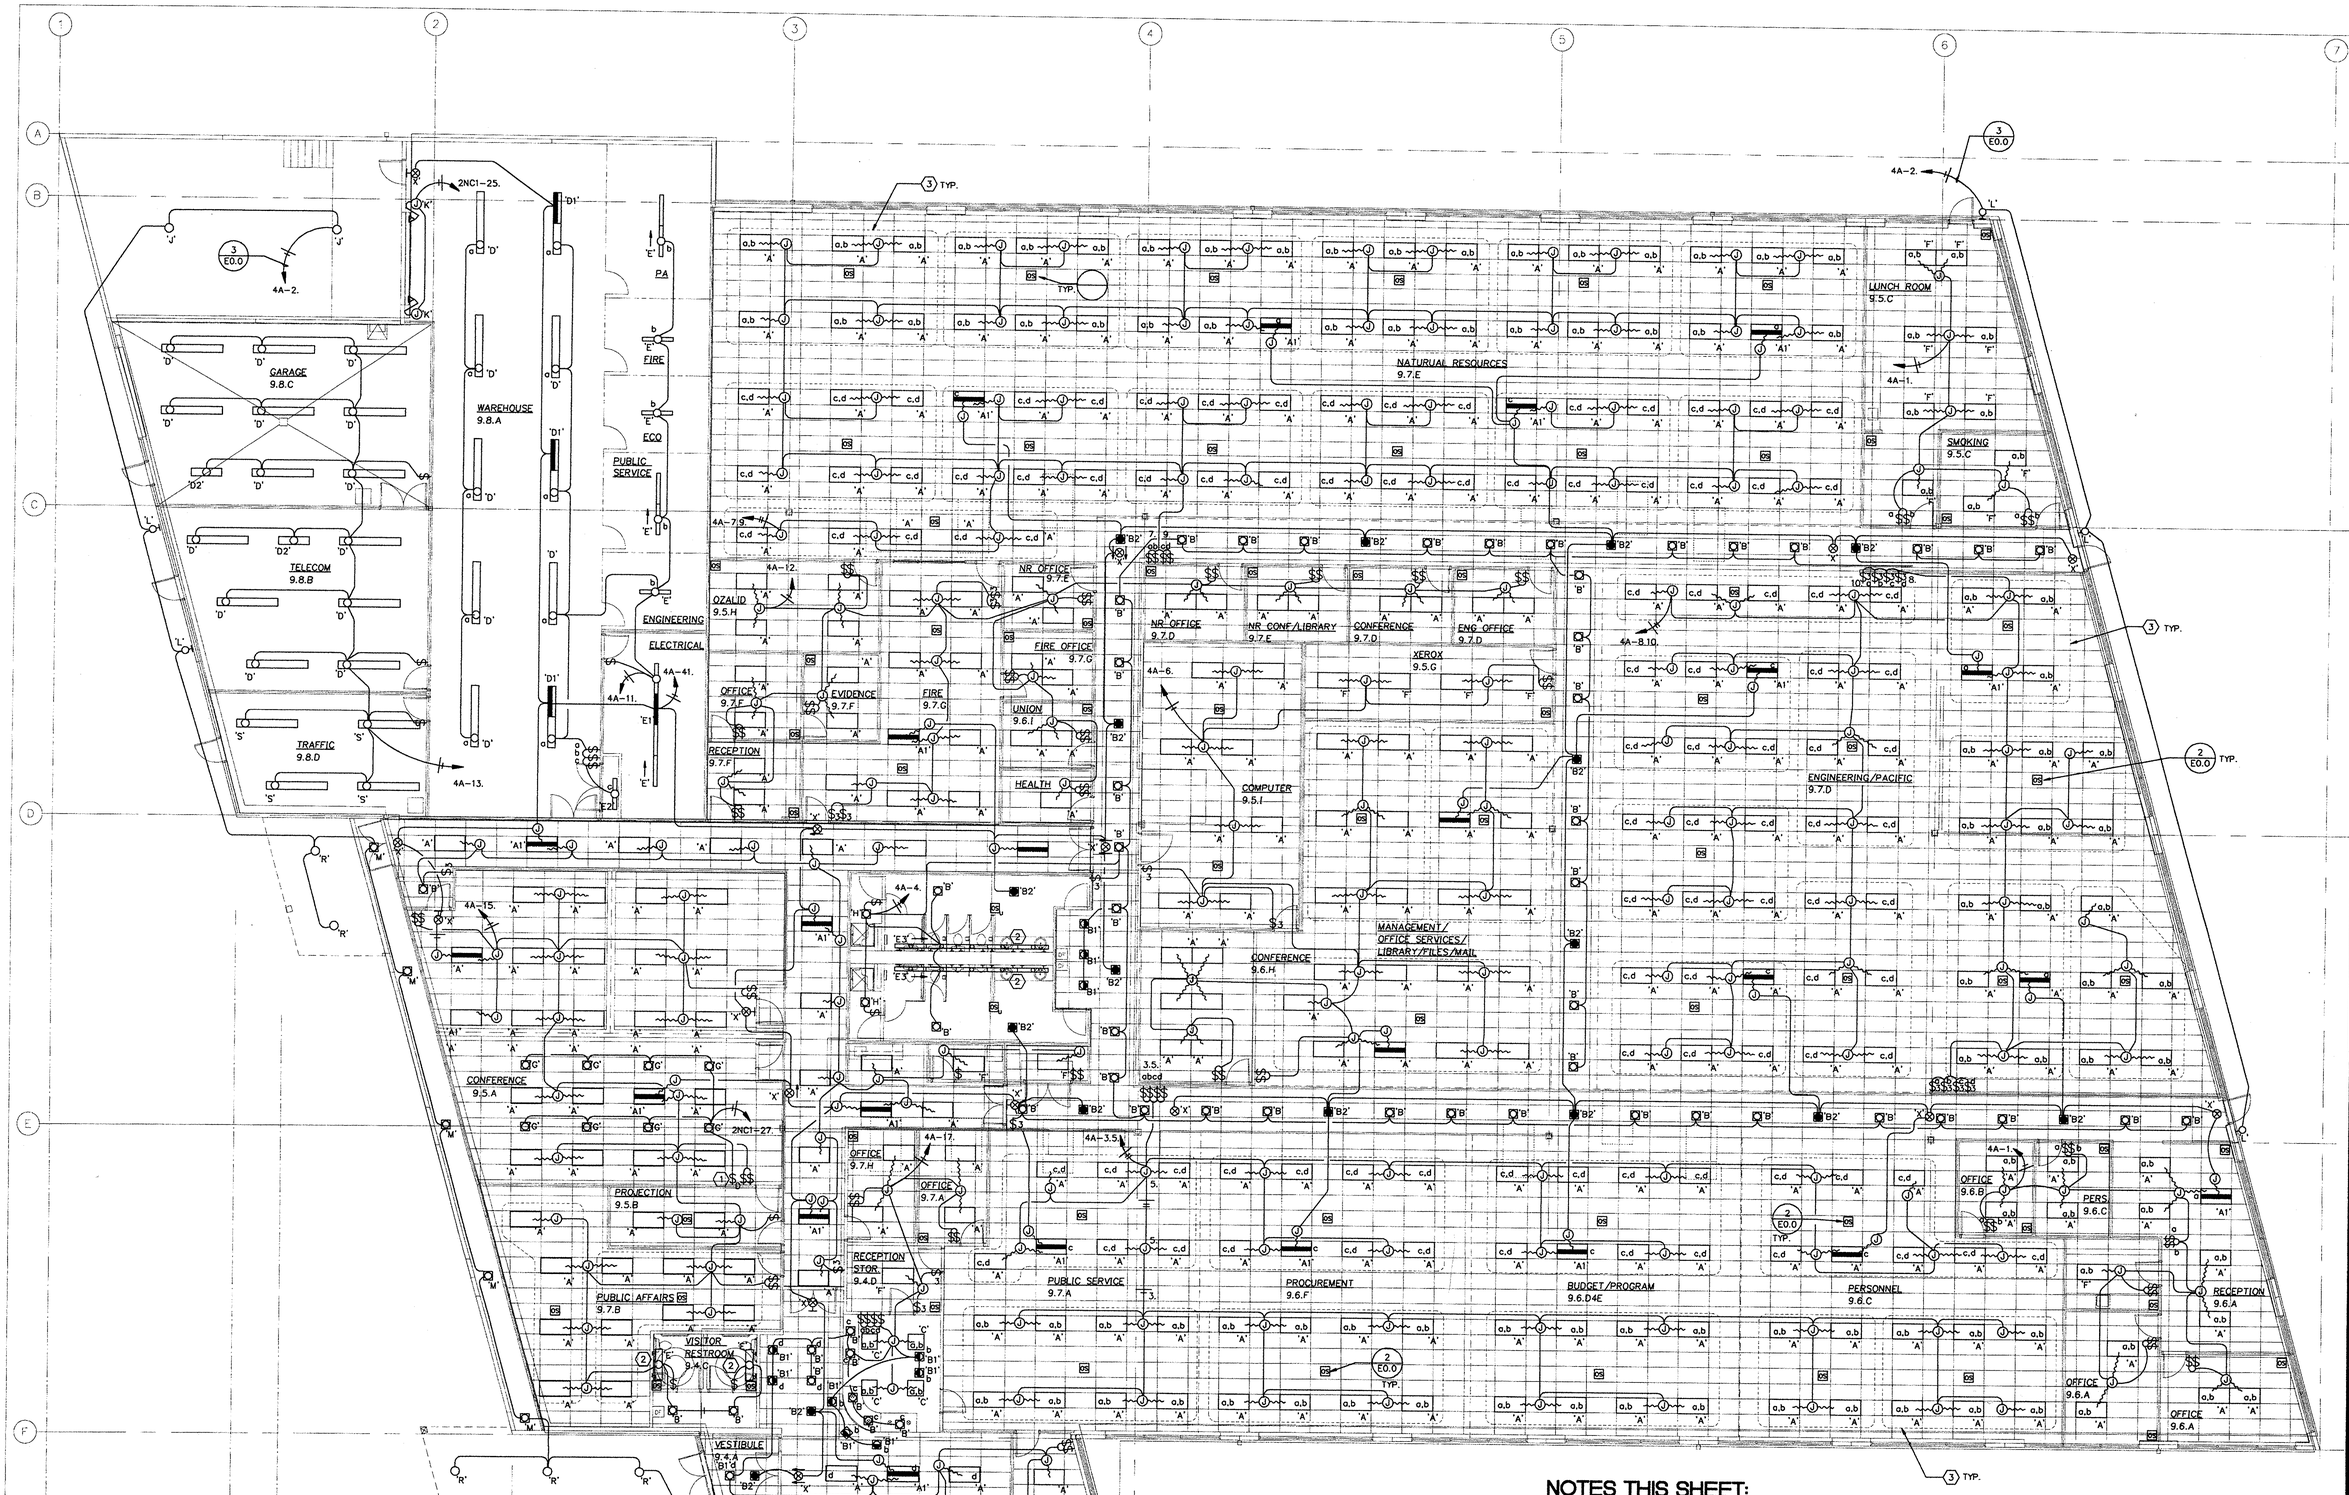

NOTES THIS SHEET:

1. PROVIDE 1000 WATT WALL BOX DIMMER TO CONTROL INCANDESCENT DOWNLIGHTS. HIGH IMPACT POLYCARBONATE FACEPLATE, LOW PROFILE. WHITE FINISH. PROVIDE INTEGRAL AIR GAP SWITCH FOR ON/OFF CONTROL. 20 AMP. LITHONIA MG-1000-I-WH OR APPROVED SUBSTITUTE.
2. MOUNT LUMINAIRES IN ARCHITECTURAL COVE.
3. ALL LIGHTS IN DASHED BOX ARE CONTROLLED BY THE SAME OCCUPANCY SENSOR.

Floor Plan - LIGHTING

0 4 8 16 32

PROJECT NO.: 95-584

9668 SE Lake Road, Milwaukie, Oregon 97222
INTERFACE ENGINEERING INC.
Consulting Engineers
503 659-6594 ESSAM ELSAHILI

DATE:03-15-1996
FILE: S84FE21

MILDREN DESIGN GROUP, P.C.
ARCHITECTURE • SPACE PLANNING
11830 SW Kerr Parkway, Suite 325
Lake Oswego, Oregon 97035
(503) 244-0552

DAVID W. PICKETT
STATE OF WASHINGTON
20295
REGISTERED
PROFESSIONAL ENGINEER
EXPIRES 09.06.96

Owner:
TKS Trust

9950 SW Arctic Drive
Beaverton, OR 97005

Project:
USFS BUILDING

Sheet Title:
Floor Plan - LIGHTING

Revisions:
1 4-15-96

MILDREN DESIGN GROUP, P.C., 1995. ALL RIGHTS RESERVED ©
THESE DRAWINGS ARE THE PROPERTY OF MILDREN DESIGN GROUP, P.C. AND ARE NOT TO BE USED OR REPRODUCED IN ANY MANNER, EXCEPT WITH THE PRIOR WRITTEN PERMISSION OF MILDREN DESIGN GROUP, P.C.

Date:	March 5, 1996
Drawn by:	Checked by:
CLL	HLB
Job Number:	94174
Sheet	of:

E2.1